


constructiehout
maximale gatdiameter zonder berekening
zones waarin geen openingen mogen gemaakt worden tenzij op
advies van de ingenieur

h [mm]	d _{max} [mm]	a ₁ [mm]	a ₂ [mm]	b ₁ [mm]	b ₂ [mm]
150	15.0	150.0	225.0	30.0	90.0
160	16.0	160.0	240.0	32.0	96.0
170	17.0	170.0	255.0	34.0	102.0
175	17.5	175.0	262.5	35.0	105.0
180	18.0	180.0	270.0	36.0	108.0
184	18.4	184.0	276.0	36.8	110.4
200	20.0	200.0	300.0	40.0	120.0
210	21.0	210.0	315.0	42.0	126.0
220	22.0	220.0	330.0	44.0	132.0
240	24.0	240.0	360.0	48.0	144.0
260	26.0	260.0	390.0	52.0	156.0
280	28.0	280.0	420.0	56.0	168.0
300	30.0	300.0	450.0	60.0	180.0
320	32.0	320.0	480.0	64.0	192.0
340	34.0	340.0	510.0	68.0	204.0
360	36.0	360.0	540.0	72.0	216.0
380	38.0	380.0	570.0	76.0	228.0
400	40.0	400.0	600.0	80.0	240.0
450	45.0	450.0	675.0	90.0	270.0
500	50.0	500.0	750.0	100.0	300.0

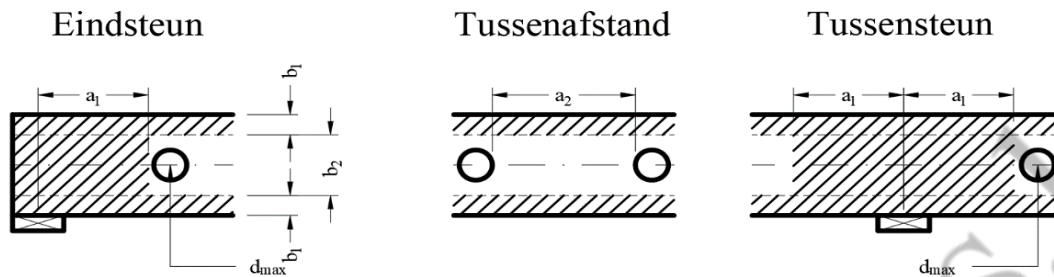

constructiehout
maximale gatdiameter , steeds na advies ingenieur
zones waarin geen openingen mogen gemaakt worden tenzij op
advies van de ingenieur

h [mm]	d_{max} [mm]	a_1 [mm]	a_2 [mm]	b_1 [mm]	b_2 [mm]
150	45.0	150.0	225.0	30.0	90.0
160	48.0	160.0	240.0	32.0	96.0
170	51.0	170.0	255.0	34.0	102.0
175	52.5	175.0	262.5	35.0	105.0
180	54.0	180.0	270.0	36.0	108.0
184	55.2	184.0	276.0	36.8	110.4
200	60.0	200.0	300.0	40.0	120.0
210	63.0	210.0	315.0	42.0	126.0
220	66.0	220.0	330.0	44.0	132.0
240	72.0	240.0	360.0	48.0	144.0
260	78.0	260.0	390.0	52.0	156.0
280	84.0	280.0	420.0	56.0	168.0
300	90.0	300.0	450.0	60.0	180.0
320	96.0	320.0	480.0	64.0	192.0
340	102.0	340.0	510.0	68.0	204.0
360	108.0	360.0	540.0	72.0	216.0
380	114.0	380.0	570.0	76.0	228.0
400	120.0	400.0	600.0	80.0	240.0
450	135.0	450.0	675.0	90.0	270.0
500	150.0	500.0	750.0	100.0	300.0